


MEMBER'S METERED CONDUCTORS TO EXTEND A MINIMUM OF 2'-0" OUT OF WEATHERHEAD. NEUTRAL MUST BE CLEARLY MARKED. HIGH LEG, IF PRESENT, MUST BE CLEARLY MARKED WITH ORANGE TAPE.

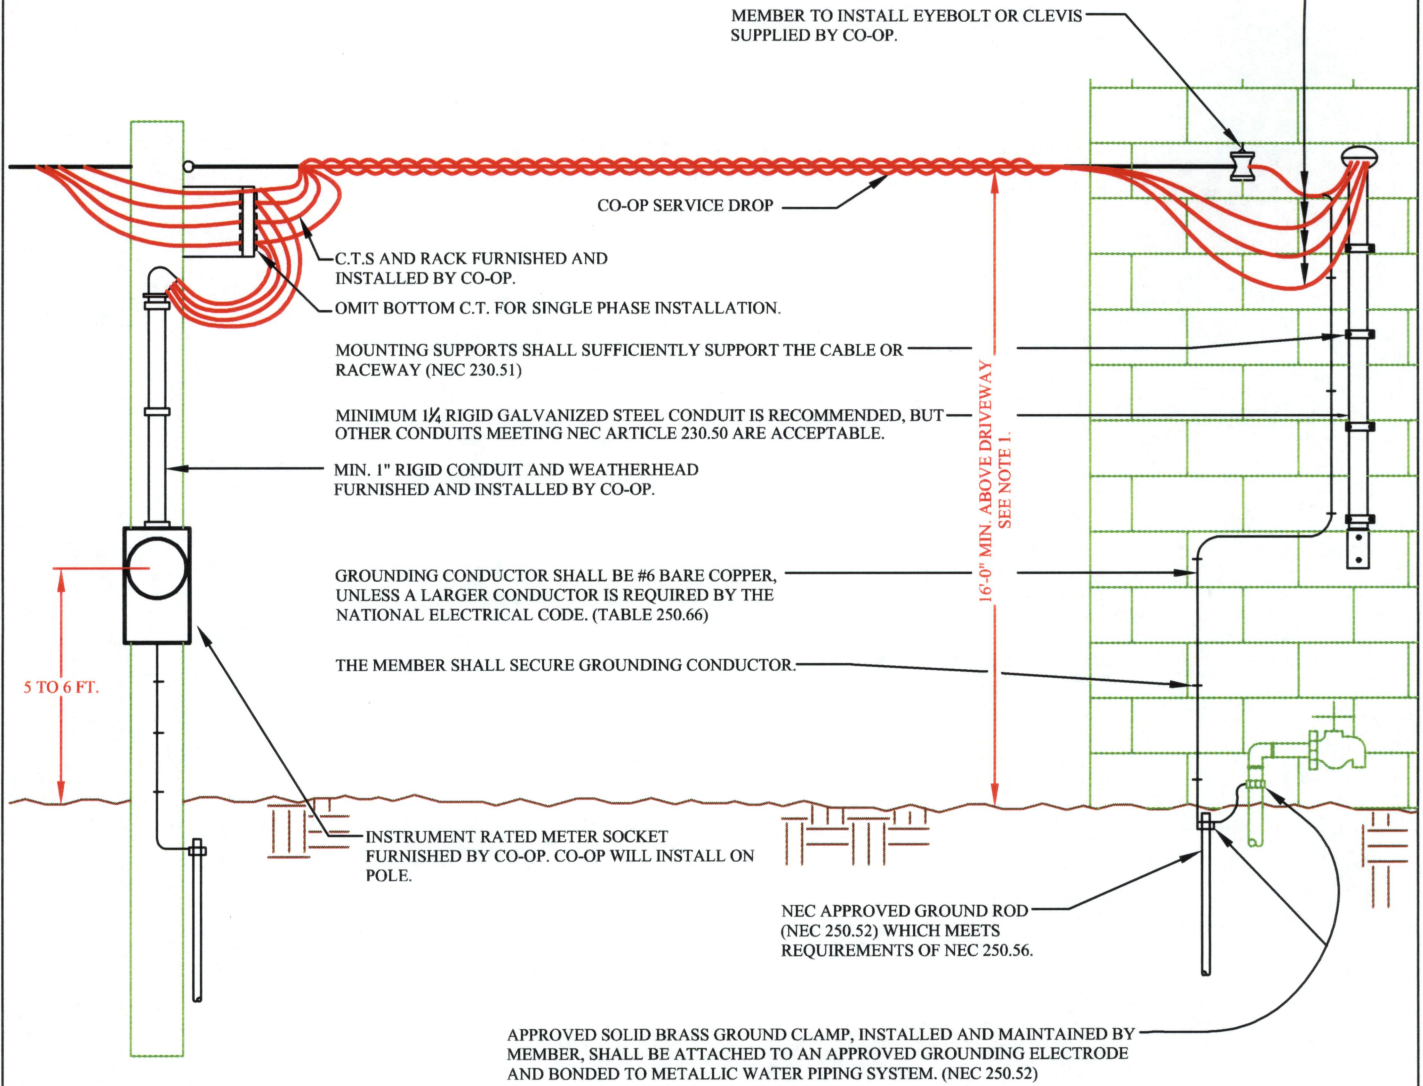

**NOTES**

1. THE MINIMUM HEIGHT OF A SERVICE DROP ACROSS A DRIVEWAY IS 16'-0", UNLESS THE HEIGHT OF THE BUILDING OR OTHER INSTALLATION DOES NOT PERMIT SERVICE DROPS TO MEET THIS VALUE. THE CLEARANCE OVER RESIDENTIAL DRIVEWAYS ONLY MAY BE REDUCED TO 12'-6" (NEC TABLE 232-1 EXCEPTION 7(a)).
2. CO-OP SHALL SPECIFY LOCATION OF SERVICE ATTACHMENT AND METER SOCKET.
3. METER MUST BE READILY ACCESSIBLE WITH NO OBSTRUCTIONS. A CLEAR WORK AREA WITH AN 18" CLEARANCE ON ALL SIDES AND A 36" CLEARANCE IN FRONT OF METER BASE IS REQUIRED. THIS CLEARANCE MUST EXTEND TO A HEIGHT OF 84".
4. SINGLE PHASE PROTECTIVE DEVICES ARE RECOMMENDED FOR MOTORS.
5. ANTI-OXIDANT COMPOUND IS REQUIRED ON ALL CONNECTIONS TO ALUMINUM CONDUCTORS.
6. IF A CONDUIT OF GREATER THAN 10FT. IN TOTAL LENGTH IS REQUIRED, THE THREADED COUPLING AND SHORT PIECE MUST BE ON THE END OPPOSITE THE WEATHERHEAD.

			DATE: 2-11-05	<b>THREE PHASE FOUR WIRE SERVICE (OVER 600 AMPS) C.T. INSTALLATION ON POLE</b> STANDARD ELECTRIC SERVICE REQUIREMENTS CULLMAN ELECTRIC COOPERATIVE CULLMAN, ALABAMA	SPEC. NO. <b>CT-2</b>
			DRAWN BY: S.T.W		
			APP'D BY:		
NO.	REVISION	DATE			